



Tel +1 (717) 767-6511  
 Fax +1 (717) 764-0839  
 www.redlion.net

Bulletin No. CT-F  
 Drawing No. LP0330  
 Released 2/05

## MODEL CT - CURRENT TRANSFORMER




### SPECIFICATIONS

1. **Operating Frequency:** 50 to 400 Hz.
2. **Insulation Class:** 0.6 KV BIL 10 KV full wave.
3. **Terminals:** Brass studs No. 8-32 UNC with flat washer and hex nuts.
4. **Window Diameter:** 1.13" (28.7 mm).
5. **Weight:** 8.0 oz (226.0 g).

UL Recognized Component  
 (Instrument Transformers, Inc., PN# 2SFT500-0.1, 2SFT500, 2SFT201,  
 File # E93779)

*Note: The listed current ratio of the current transformer is based on the primary conductor passing once through the transformer opening. The ratio is reduced in multiples by looping the conductor through the opening. A transformer having a ratio 200:5 changes to a ratio of 100:5 if two loops are made through the transformer with the primary conductor. The ratio of the transformer will be 50:5 if four loops are made with the primary conductor, etc.*

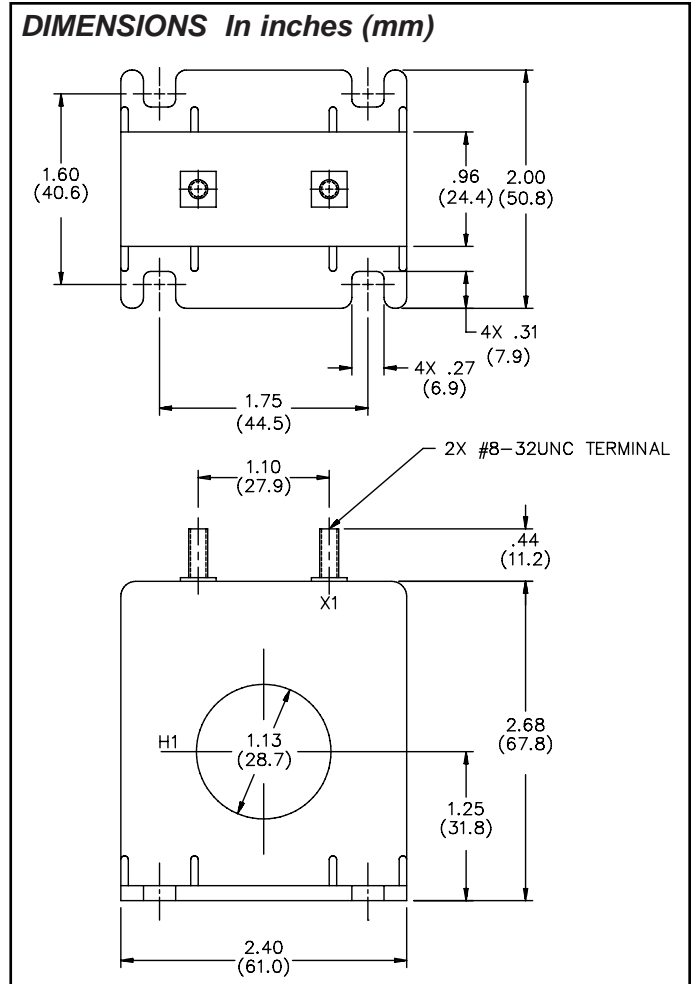

### ORDERING INFORMATION

CURRENT RATIO	ACCURACY @ 60 Hz	VA 60 Hz BURDEN	MAXIMUM OUTPUT WIRE DISTANCE BETWEEN CT AND METER				PART NUMBERS
			18 AWG	16 AWG	14 AWG	12 AWG	
50:0.1	±5.0%	2.5	Wire distance is not an issue due to the low current flow. Wires may be as long as needed.				CT005001
50:5	±3.0%	2.0	5.0 ft.	7.5 ft.	12 ft.	18 ft.	CT005050
200:5	±1.0%	4.0	10 ft.	17.5 ft.	28 ft.	43 ft.	CT020050

Red Lion Controls  
 20 Willow Springs Circle  
 York PA 17402  
 Tel +1 (717) 767-6511  
 Fax +1 (717) 764-0839

Red Lion Controls BV  
 Basicweg 11b  
 NL - 3821 BR Amersfoort  
 Tel +31 (0) 334 723 225  
 Fax +31 (0) 334 893 793

Red Lion Controls AP  
 31, Kaki Bukit Road 3,  
 #06-04/05 TechLink  
 Singapore 417818  
 Tel +65 6744-6613  
 Fax +65 6743-3360